


MINIMUM CONDENSATE PIPE SIZE			
EQUIPMENT CAPACITY IN TONS OF REFRIGERANT (KW)		CONDENSATE PIPE MINIMUM DIAMETER IN INCHES (mm)	
UP TO 20	(UP TO 70.34)	3/4	(20)
21-40	(73.85-140.67)	1	(25)
41-90	(144.19-316.5)	1-1/4	(32)
91-125	(320.03-439.6)	1-1/2	(40)
126-250	(443.12-879.2)	2	(50)

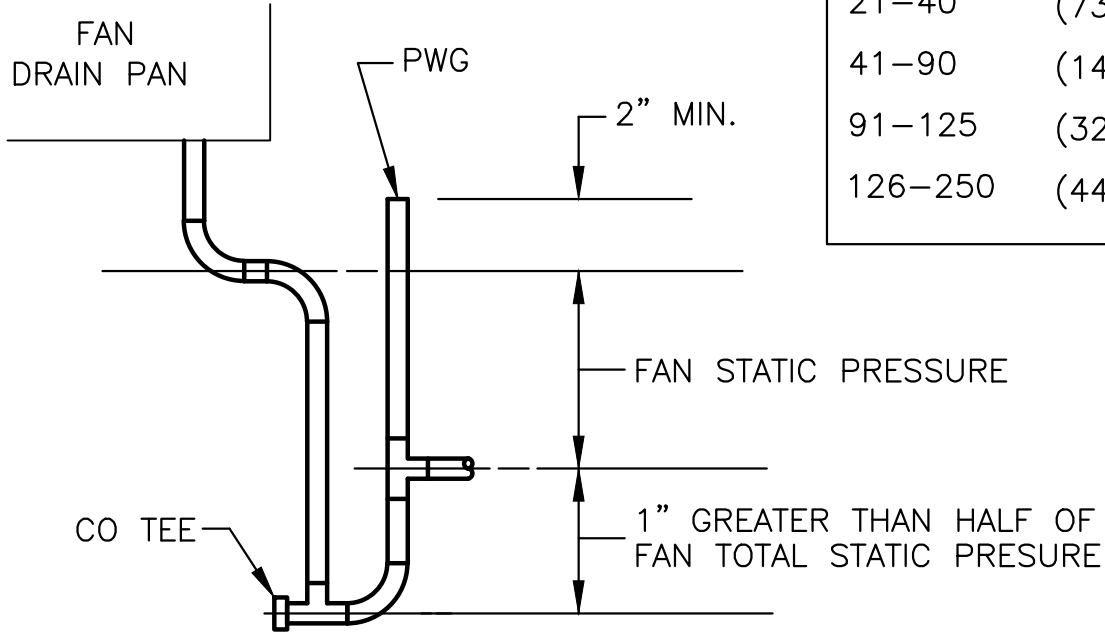

NOTE:

1. FERMIN CHILLER, HEAT AND HYDRONIC SUPPLY
3-BAY SINK DRAIN, WALL HUNG
2. DRAIN LINE SHALL PENETRATE THE ROOF LINE WITHIN THE
CONFINEMENT OF THE HVAC EQUIPMENT CURB.

CONDENSATE DRAIN TRAP AT FAN DRAIN PAN DETAIL

N.T.S.

